


2002 Water Quality Report for Courthouse Bay Water Treatment System

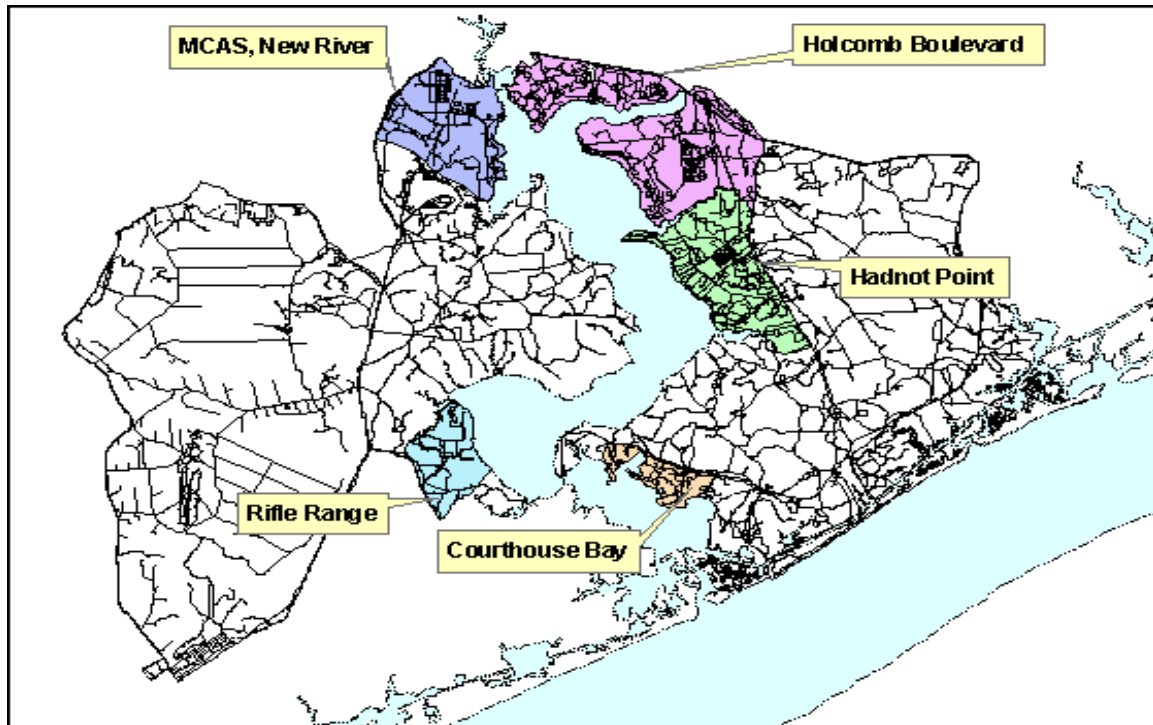

For more information

Courthouse Bay Water Treatment
Attn: Brynn Ashton
Marine Corps Base, Camp Lejeune
PSC Box 20004
Camp Lejeune, NC 28542-0004

Phone: 910-451-5068

Fax: 910-451-5997

E-mail: ashtonbt@lejeune.usmc.mil

Web Address: www.lejeune.usmc/emd

2002 Water Quality Report for Courthouse Bay Water Treatment System

Is my water safe?

MCB, Camp Lejeune is committed to providing you with drinking water that is safe and reliable. We believe that providing you with accurate information about your water is the best way to assure you that your water is safe. This 2002 Water Quality Report for the Courthouse Bay Water Treatment System explains where your water comes from and lists all of the contaminants detected in your drinking water. We routinely test your water for over 80 different EPA regulated chemical and microbiological contaminants. We are happy to report that last year your tap water met all U.S. Environmental Protection Agency (EPA) and State drinking water health standards.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

Where does my water come from?

The Courthouse Bay community water system obtains water from seven (7) groundwater wells. Groundwater is pumped from the Castle Hayne aquifer approximately 180 feet below the ground. This water is relatively free of contaminants. It is pumped from the wells to a detention basin located at the Courthouse Bay Water Treatment Plant. At the detention basin air is bubbled through the water, calcium carbonate is added (to raise the pH of the water), and chlorine is added to the water to protect against microbial contamination. This water is then pumped to a series of pressure filters to remove particles. After filtration, the water is passed through a set of softening units to remove minerals and then is stored in a large reservoir called a clearwell. When you open a faucet or turn on a water hose, treated drinking water from the clearwell is pumped through the distribution system to your taps.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria, may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife. Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming and pesticides

and herbicides that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can, also come from gas stations, urban stormwater runoff, and septic systems. Radioactive contaminants can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Educational Statement for Lead

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to two (2) minutes before using tap water. Additional information is available from Safe Drinking Water Hotline (800-426-4791).

Water Quality Data Table

The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. The presence of contaminants in the water does not necessarily indicate that the water poses a health risk. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Contaminants (units)	MCLG	MCL	Your Water	Range Low High	Sample Date	Violation	Typical Source
----------------------	------	-----	------------	-------------------	-------------	-----------	----------------

Volatile Organic Contaminants

TTHMs [Total Trihalomethanes] (ppb)	NA	100	59.91	35 89.9	----	No	By-product of drinking water chlorination
-------------------------------------	----	-----	-------	---------	------	----	---

Contaminant(s) (units)	MCLG	AL	Your Water	# of Samples > AL	Sample Date	Exceeds AL	Typical Source
------------------------	------	----	------------	----------------------	-------------	---------------	----------------

Inorganic Contaminants

Copper (ppm)	1.3	1.3	0.635	0	09/2002	No	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems
Lead (ppb)	0	15	5	1	09/2002	No	Corrosion of household plumbing systems; Erosion of natural deposits

Units Description:

NA: Not applicable

ND: Not detected

NR: Not reported

MNR: Monitoring not required, but recommended.

ppm: parts per million, or milligrams per liter (mg/L)

ppb: parts per billion, or micrograms per liter (µg/L)

Important Drinking Water Definitions:

AL: Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Contaminant: Any natural or man-made physical, chemical, biological, or radiological substance or matter in water, which is at a level that may have an adverse effect on public health, and which is known or anticipated to occur in public water systems.

Coliform: A group of bacteria commonly found in the environment. They are an indicator of potential contamination of water. Adequate and appropriate disinfection effectively destroys coliform bacteria.

Disinfection: A process that effectively destroys coliform bacteria.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MRDL: Maximum residual disinfectant level. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Nitrates: A dissolved form of nitrogen found in fertilizers and sewage by-products that may leach into groundwater and other water sources. Nitrates may also occur naturally in some waters.

NTU: (Nephelometric turbidity unit) A measure of the clarity of water.

Pathogens: (Disease-causing pathogens, waterborne pathogens) A pathogen is a bacterium, virus, or parasite that causes or is capable of causing disease. Pathogens may contaminate water and cause waterborne disease.


pCi/L: (picocuries per liter) A measurement of radiation released by a set amount of a certain compound.

pH: A measure of the acidity or alkalinity of water.

ppb, ppm: (Part per billion, part per million) Measurements of the amount of contaminant per unit of water. A part per million is like one cent in \$10,000 and a part per billion is like one cent in \$10,000,000.

THM: (Trihalomethanes) Four separate compounds (chloroform, dichlorobromomethane, dibromochloromethane, and bromoform) that form as a result of disinfection.

2002 Water Quality Report for MCAS, New River Water Treatment System

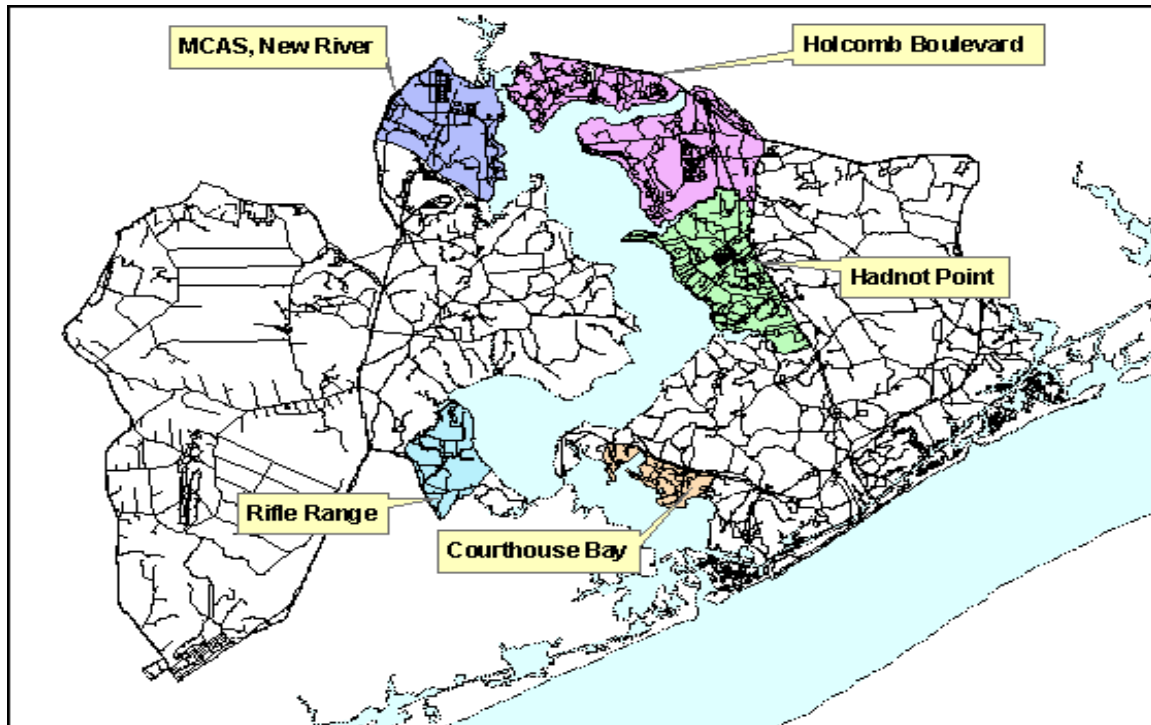

For more information

MCAS, New River Water Treatment
Attn: Brynn Ashton
Marine Corps Base, Camp Lejeune
PSC Box 20004
Camp Lejeune, NC 28542-0004

Phone: 910-451-5068

Fax: 910-451-5997

E-mail: ashtonbt@lejeune.usmc.mil

Web Address: www.lejeune.usmc.mil/emd

2002 Water Quality Report for MCAS, New River Water Treatment System

Is my water safe?

MCB, Camp Lejeune is committed to providing you with drinking water that is safe and reliable. We believe that providing you with accurate information about your water is the best way to assure you that your water is safe. This 2002 Water Quality Report for the MCAS, New River Water Treatment System explains where your water comes from and lists all of the contaminants detected in your drinking water. We routinely test your water for over 80 different EPA regulated chemical and microbiological contaminants. We are happy to report that last year your tap water met all U.S. Environmental Protection Agency (EPA) and State drinking water health standards.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

Where does my water come from?

The Marine Corps Air Station, New River community water system obtains water from 13 groundwater wells located in the Verona Loop area. Groundwater is pumped from the Castle Hayne freshwater aquifer approximately 180 feet below the ground. This water is relatively free of contaminants. It is pumped from the wells to a water treatment plant located on the air station. The water enters the water treatment plant and is pumped into a set of cone-shaped devices called spiractors. The spiractors are used to soften the water by removing minerals. The water is then passed through a set of filters, which contain layers of sand and carbon to remove particles through a process called filtration. The clean water is then placed in a large storage tank called a clearwell. When water is needed by customers, the water is pumped from the clearwell; chlorine is added (to protect against microbial contamination) and distributed throughout the MCAS New River community water system.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife. Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from

urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming. Pesticides and herbicides may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals that are by-products of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems. Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Educational Statement for Lead

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to two (2) minutes before using tap water. Additional information is available from Safe Drinking Water Hotline (800-426-4791).

Water Quality Data Table

The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. The presence of contaminants in the water does not necessarily indicate that the water poses a health risk. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Contaminants (units)	MCLG	MCL	Your Water	Range		Sample Date	Violation	Typical Source
				Low	High			
Volatile Organic Contaminants								
TTHMs [Total Trihalomethanes] (ppb)	NA	100	74.74	44.17	94.9	----	No	By-product of water chlorination

Contaminant(s) (units)	MCLG	AL	Your Water	# of Samples > AL	Sample Date	Exceeds AL	Typical Source
Copper (ppm)	1.3	1.3	0.074	0	2001 Data	No	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems
Lead (ppb)	0	15	15	5	2001 Data	No	Corrosion of household plumbing systems; Erosion of natural deposits

Units Description:

NA: Not applicable

ND: Not detected

NR: Not reported

MNR: Monitoring not required, but recommended.

ppm: parts per million, or milligrams per liter (mg/L)

ppb: parts per billion, or micrograms per liter (µg/L)

Important Drinking Water Definitions:

AL: Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Contaminant: Any natural or man-made physical, chemical, biological, or radiological substance or matter in water, which is at a level that may have an adverse effect on public health, and which is known or anticipated to occur in public water systems.

Coliform: A group of bacteria commonly found in the environment. They are an indicator of potential contamination of water. Adequate and appropriate disinfection effectively destroys coliform bacteria.

Disinfection: A process that effectively destroys coliform bacteria.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MRDL: Maximum residual disinfectant level. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Nitrates: A dissolved form of nitrogen found in fertilizers and sewage by-products that may leach into groundwater and other water sources. Nitrates may also occur naturally in some waters.

NTU: (Nephelometric turbidity unit) A measure of the clarity of water.

Pathogens: (Disease-causing pathogens, waterborne pathogens) A pathogen is a bacterium, virus, or parasite that causes or is capable of causing disease. Pathogens may contaminate water and cause waterborne disease.


pCi/L: (picocuries per liter) A measurement of radiation released by a set amount of a certain compound.

pH: A measure of the acidity or alkalinity of water.

ppb, ppm: (Part per billion, part per million) Measurements of the amount of contaminant per unit of water. A part per million is like one cent in \$10,000 and a part per billion is like one cent in \$10,000,000.

THM: (Trihalomethanes) Four separate compounds (chloroform, dichlorobromomethane, dibromochloromethane, and bromoform) that form as a result of disinfection.

2002 Water Quality Report for Hadnot Point Water Treatment System

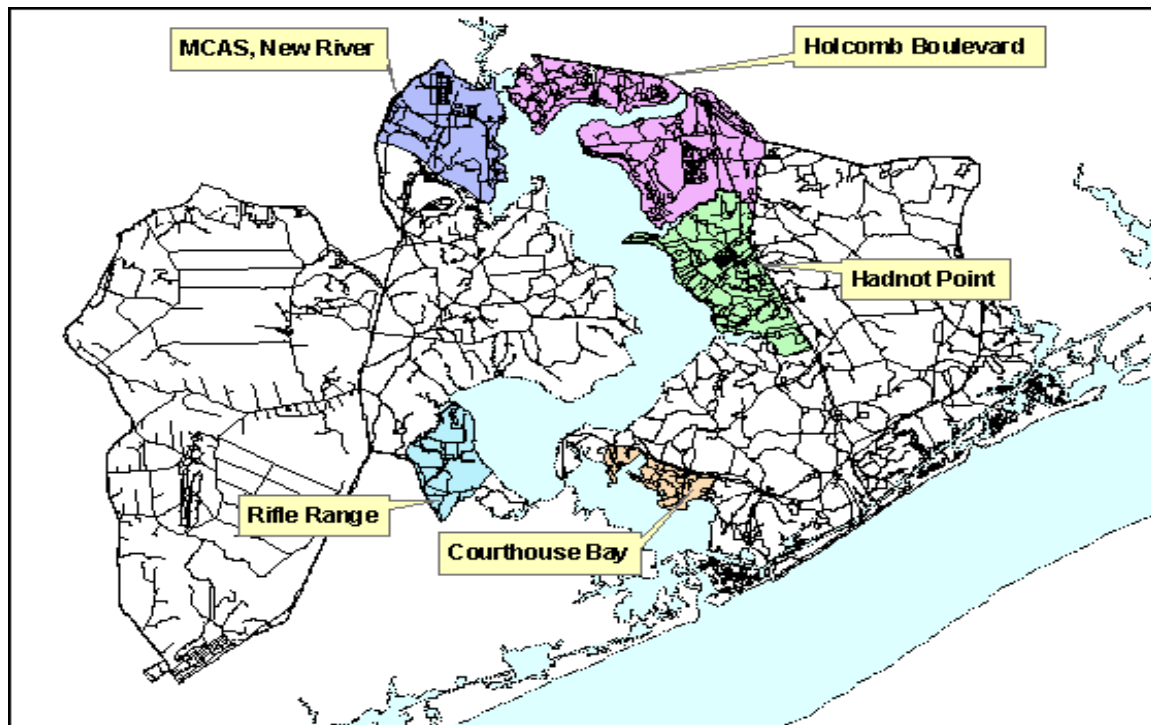

For more information

Hadnot Point Water Treatment
Attn: Brynn Ashton
Marine Corps Base, Camp Lejeune
PSC Box 20004
Camp Lejeune, NC 28542-0004

Phone: 910-451-5068

Fax: 910-451-5997

E-mail: ashtonbt@lejeune.usmc.mil

Web Address: www.lejeune.usmc.mil

2002 Water Quality Report for Hadnot Point Water System

Is my water safe?

MCB, Camp Lejeune is committed to providing you with drinking water that is safe and reliable. We believe that providing you with accurate information about your water is the best way to assure you that your water is safe. This 2002 Water Quality Report for the Hadnot Point Water Treatment System explains where your water comes from and lists all of the contaminants detected in your drinking water. We routinely test your water for over 80 different EPA regulated chemical and microbiological contaminants. We are happy to report that last year your tap water met all U.S. Environmental Protection Agency (EPA) and State drinking water health standards.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

Where does my water come from?

The Hadnot Point community water system obtains water from 31 groundwater wells located on Base. Groundwater is pumped from the Castle Hayne aquifer, approximately 180 feet below the ground. This water, which is relatively free of contaminants, is pumped from the wells to a water treatment plant located on the main portion of the Base. As the raw water enters the storage reservoir, chlorine is added to protect against microbial contamination. Raw water pumps are used to move the water from the reservoir to a set of large, cone-shaped devices called spiractors. The spiractors are used to soften the water by removing minerals. Lime is added at the bottom of the spiractors to assist in the softening process. The water is then passed through a set of filters, which contain layers of sand and carbon, to remove particles through a process called filtration. Fluoride (to prevent tooth decay) is added to the water as it is placed in a large storage tank called a clearwell. When customers need water, treated water is pumped from the clear well and distributed throughout the Hadnot Point community water system.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria, may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife. Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban

stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming. Pesticides and herbicides may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production can also come from gas stations, urban stormwater runoff, and septic systems. Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Educational Statement for Lead

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to two (2) minutes before using tap water. Additional information is available from Safe Drinking Water Hotline (800-426-4791).

Water Quality Data Table

The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. The presence of contaminants in the water does not necessarily indicate that the water poses a health risk. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Contaminants (units)	MCLG	MCL	Your Water	Range Low High	Sample Date	Violation	Typical Source
----------------------	------	-----	------------	-------------------	-------------	-----------	----------------

Volatile Organic Contaminants							
TTHMs [Total Trihalomethanes] (ppb)	NA	100	29.65	22.6 35	----	No	By-product of drinking water chlorination

Contaminant(s) (units)	MCLG	AL	Your Water	# of Samples > AL	Sample Date	Exceeds AL	Typical Source
------------------------	------	----	------------	-------------------	-------------	------------	----------------

Inorganic Contaminants							
Copper (ppm)	1.3	1.3	0.074	0	2001 Data	No	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems

Lead (ppb)	0	15	15	5	2001 Data	No	Corrosion of household plumbing systems; Erosion of natural deposits
------------	---	----	----	---	------------------	----	--

Units Description:

NA: Not applicable

ND: Not detected

NR: Not reported

MNR: Monitoring not required, but recommended.

ppm: parts per million, or milligrams per liter (mg/L)

ppb: parts per billion, or micrograms per liter (µg/L)

Important Drinking Water Definitions:

AL: Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Contaminant: Any natural or man-made physical, chemical, biological, or radiological substance or matter in water, which is at a level that may have an adverse effect on public health, and which is known or anticipated to occur in public water systems.

Coliform: A group of bacteria commonly found in the environment. They are an indicator of potential contamination of water. Adequate and appropriate disinfection effectively destroys coliform bacteria.

Disinfection: A process that effectively destroys coliform bacteria.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MRDL: Maximum residual disinfectant level. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Nitrates: A dissolved form of nitrogen found in fertilizers and sewage by-products that may leach into groundwater and other water sources. Nitrates may also occur naturally in some waters.

NTU: (Nephelometric turbidity unit) A measure of the clarity of water.

Pathogens: (Disease-causing pathogens, waterborne pathogens) A pathogen is a bacterium, virus, or parasite that causes or is capable of causing disease. Pathogens may contaminate water and cause waterborne disease.


pCi/L: (picocuries per liter) A measurement of radiation released by a set amount of a certain compound.

pH: A measure of the acidity or alkalinity of water.

ppb, ppm: (Part per billion, part per million) Measurements of the amount of contaminant per unit of water. A part per million is like one cent in \$10,000 and a part per billion is like one cent in \$10,000,000.

THM: (Trihalomethanes) Four separate compounds (chloroform, dichlorobromomethane, dibromochloromethane, and bromoform) that form as a result of disinfection.

2002 Water Quality Report for Holcomb Boulevard Water Treatment System

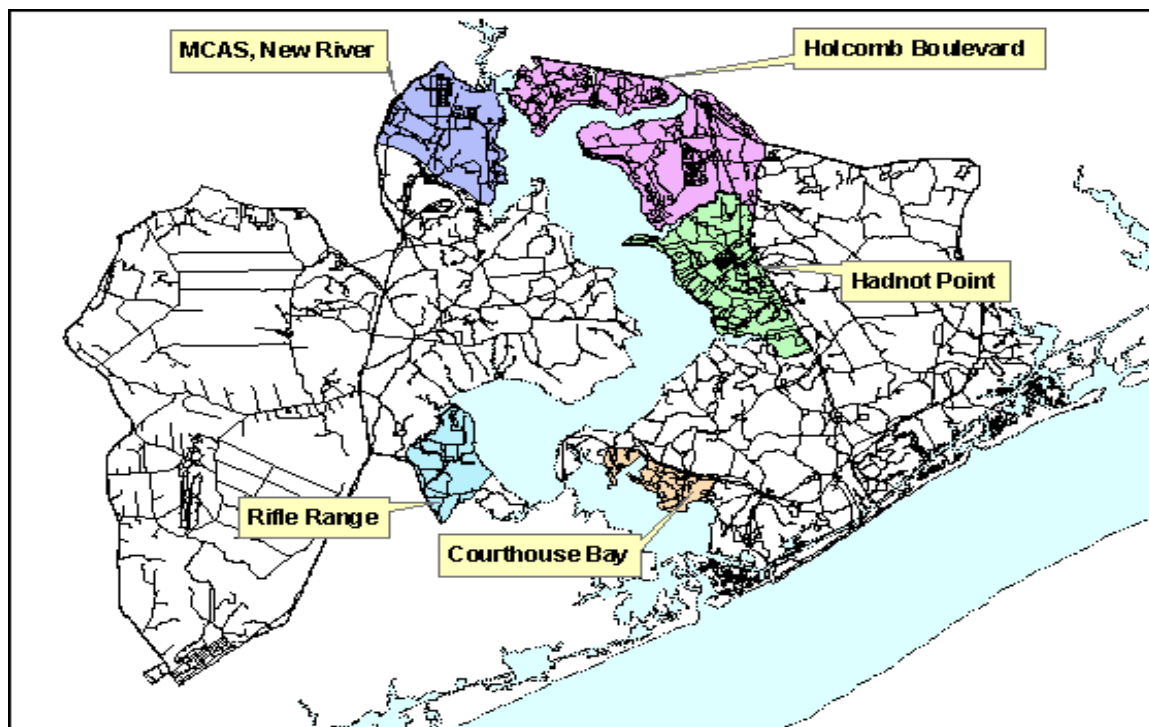

For more information

Holcomb Boulevard Water Treatment
Attn: Brynn Ashton
Marine Corps Base, Camp Lejeune
PSC Box 20004
Camp Lejeune, NC 28542-0004

Phone: 910-451-5068

Fax: 910-451-5997

E-mail: ashtonbt@lejeune.usmc.mil

Web Address: www.lejeune.usmc.mil/emd

2002 Water Quality Report for Holcomb Boulevard Water Treatment System

Is my water safe?

MCB, Camp Lejeune is committed to providing you with drinking water that is safe and reliable. We believe that providing you with accurate information about your water is the best way to assure you that your water is safe. This 2002 Water Quality Report for the Holcomb Boulevard Water Treatment System explains where your water comes from and lists all of the contaminants detected in your drinking water. We routinely test your water for over 80 different EPA regulated chemical and microbiological contaminants. Last year one sampling event exceeded the Action Level for lead at the Holcomb Boulevard Plant. However, follow up samples were below this level. A more intense sampling plan for lead and copper will be initiated in 2003.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

Where does my water come from?

The Holcomb Boulevard community water system obtains water from 21 groundwater wells located on Base. Groundwater is pumped from the Castle Hayne freshwater aquifer, approximately 180 feet below the ground. This water, which is relatively free of contaminants, is pumped from the wells to a water treatment plant located near the main gate of the Base. As the water enters the water treatment plant it is chlorinated to protect against microbial contamination and placed into a storage reservoir. From the storage reservoir the water is moved to a set of large, cone-shaped devices called spiractors. The spiractors are used to soften the water by removing minerals. Lime is added at the bottom of the spiractors to aid the softening process. The water is then passed through a set of filters, which contain layers of sand and carbon, to remove particles through a process called filtration. Fluoride (to prevent tooth decay) is added to the water and then the clean water is placed in a large storage tank called a clearwell. When water is needed by customers, it is pumped from the clearwell and distributed throughout the Holcomb Boulevard community water system.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791). The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria, may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or farming. Pesticides and herbicides may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can, also come from gas stations, urban stormwater runoff, and septic systems. Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Educational Statement for Lead

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to two (2) minutes before using tap water. Additional information is available from Safe Drinking Water Hotline (800-426-4791).

Water Quality Data Table

The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. The presence of contaminants in the water does not necessarily indicate that the water poses a health risk. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Contaminants (units)	MCLG	MCL	Your Water	Range Low	Range High	Sample Date	Violation	Typical Source
Volatile Organic Contaminants								
TTHMs [Total Trihalomethanes] (ppb)	NA	100	50.29	27.6	67.2	---	No	By-product of drinking water chlorination

Contaminant(s) (units)	MCLG	AL	Your Water	# of Samples > AL	Sample Date	Exceeds AL	Typical Source
Inorganic Contaminants							
Copper (ppm)	1.3	1.3	0.103	0	09/2002	No	Erosion of natural deposits; leaching from wood preservatives; Corrosion of household plumbing systems
Lead (ppb)	0	15	20	5	09/2002	Yes	Corrosion of household plumbing systems; Erosion of natural deposits

Units Description:

NA: Not applicable

ND: Not detected

NR: Not reported

MNR: Monitoring not required, but recommended.

ppm: parts per million, or milligrams per liter (mg/L)

ppb: parts per billion, or micrograms per liter (µg/L)

Important Drinking Water Definitions:

AL: Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Contaminant: Any natural or man-made physical, chemical, biological, or radiological substance or matter in water, which is at a level that may have an adverse effect on public health, and which is known or anticipated to occur in public water systems.

Coliform: A group of bacteria commonly found in the environment. They are an indicator of potential contamination of water. Adequate and appropriate disinfection effectively destroys coliform bacteria.

Disinfection: A process that effectively destroys coliform bacteria.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MRDL: Maximum residual disinfectant level. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Nitrates: A dissolved form of nitrogen found in fertilizers and sewage by-products that may leach into groundwater and other water sources. Nitrates may also occur naturally in some waters.

NTU: (Nephelometric turbidity unit) A measure of the clarity of water.

Pathogens: (Disease-causing pathogens, waterborne pathogens) A pathogen is a bacterium, virus, or parasite that causes or is capable of causing disease. Pathogens may contaminate water and cause waterborne disease.

pCi/L: (picocuries per liter) A measurement of radiation released by a set amount of a certain compound.

pH: A measure of the acidity or alkalinity of water.

ppb, ppm: (Part per billion, part per million) Measurements of the amount of contaminant per unit of water. A part per million is like one cent in \$10,000 and a part per billion is like one cent in \$10,000,000.

THM: (Trihalomethanes) Four separate compounds (chloroform, dichlorobromomethane, dibromochloromethane, and bromoform) that form as a result of disinfection.


Violations:

Lead

Infants and children who drink water containing lead in excess of the action level could experience delays in their physical or mental development. Children could show slight deficits in attention span and learning

abilities. Adults who drink this water over many years could develop kidney problems or high blood pressure.

2002 Water Quality Report for Rifle Range Water Treatment System

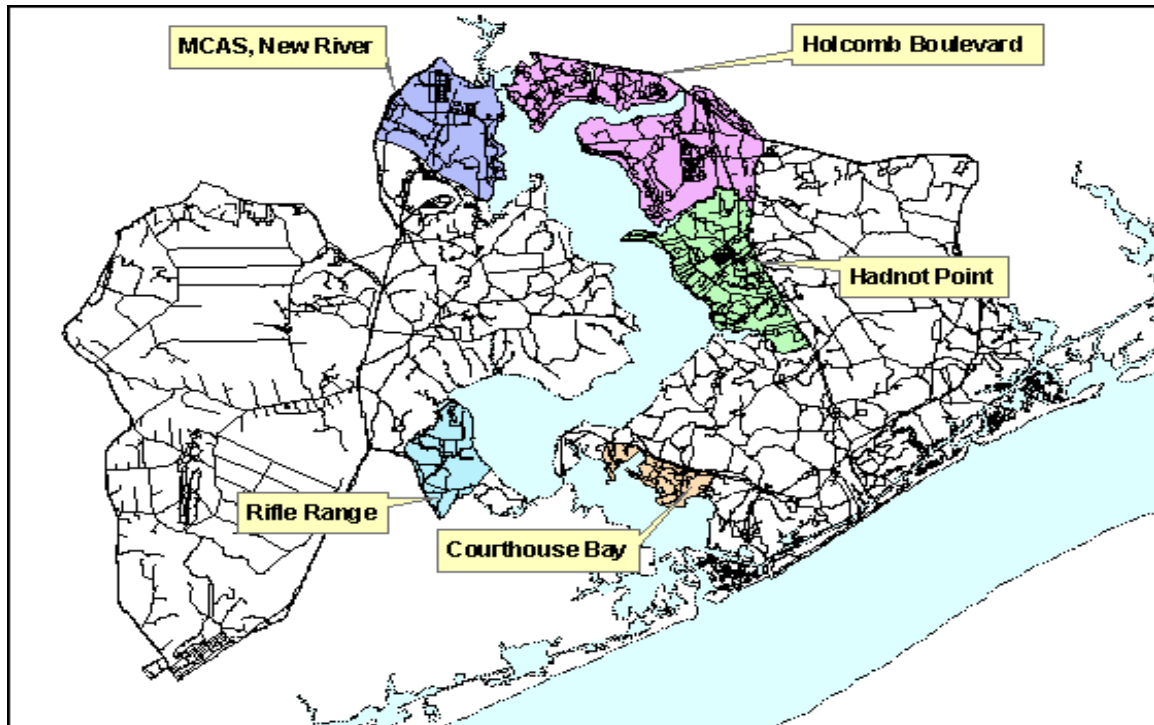

For more information

**Rifle Range Water Treatment
Attn: Brynn Ashton
Marine Corps Base, Camp Lejeune
PSC Box 20004
Camp Lejeune, NC 28542-0004**

**Phone: 910-451-5068
Fax: 910-451-5997
E-mail: ashtonbt@lejeune.usmc.mil**

Web Address: www.lejeune.usmc.mil/emd

2002 Water Quality Report for Rifle Range Water Treatment System

Is my water safe?

MCB, Camp Lejeune is committed to providing you with drinking water that is safe and reliable. We believe that providing you with accurate information about your water is the best way to assure you that your water is safe. This 2002 Water Quality Report for the Rifle Range Water Treatment System explains where your water comes from and lists all of the contaminants detected in your drinking water. We routinely test your water for over 80 different EPA regulated chemical and microbiological contaminants. Last year one sampling event exceeded the Action Level for lead at the Rifle Range. However, follow up samples were below this level. A more intense sampling plan for lead and copper will be initiated in 2003.

Do I need to take special precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Water Drinking Hotline (800-426-4791).

Where does my water come from?

The Marine Corps Base, Camp Lejeune Rifle Range Water System is supplied with drinking water from Onslow County. Onslow County obtains raw water from the Black Creek and Castle Hayne groundwater aquifers. Onslow County maintains and operates a series of groundwater pumps that are used to withdraw raw water from these aquifers and transfer the raw water to Onslow County's Water Treatment Plant. At the treatment plant, licensed operators are responsible for using state-of-the-art equipment to remove contaminants from the water. As the water is pumped from the water treatment plant, chlorine is added to protect against microbial contamination. This treated water passes through the Onslow County water distribution system and then to the MCB, Camp Lejeune Rifle Range Water System.

Why are there contaminants in my drinking water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Microbial contaminants, such as viruses and bacteria may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife. Inorganic contaminants, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial, or domestic wastewater discharges, oil and gas production, mining, or

farming. Pesticides and herbicides may come from a variety of sources such as agriculture, urban stormwater runoff, and residential

uses. Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can, also come from gas stations, urban stormwater runoff, and septic systems. Radioactive contaminants, which can be naturally occurring or be the result of oil and gas production and mining activities. In order to ensure that tap water is safe to drink, EPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Educational Statement for Lead

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and flush your tap for 30 seconds to two (2) minutes before using tap water. Additional information is available from Safe Drinking Water Hotline (800-426-4791).

Water Quality Data Table

The table below lists all of the drinking water contaminants that we detected during the calendar year of this report. The presence of contaminants in the water does not necessarily indicate that the water poses a health risk. Unless otherwise noted, the data presented in this table is from testing done in the calendar year of the report. The EPA or the State requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants do not change frequently.

Contaminants (units)	MCLG	MCL	Your Water	Range Low High	Sample Date	Violation	Typical Source
----------------------	------	-----	------------	-------------------	-------------	-----------	----------------

Volatile Organic Contaminants

TTHMs [Total Trihalomethanes] (ppb)	NA	100	71.59	62 84.4	----	No	By-product of drinking water chlorination
-------------------------------------	----	-----	-------	---------	------	----	---

Contaminant(s) (units)	MCLG	AL	Your Water	# of Samples > AL	Sample Date	Exceeds AL	Typical Source
------------------------	------	----	------------	-------------------	-------------	------------	----------------

Inorganic Contaminants

Copper (ppm)	1.3	1.3	0.634	0	09/2002	No	Erosion of natural deposits; Leaching from wood preservatives; Corrosion of household plumbing systems
Lead (ppb)	0	15	29	3	09/2002	Yes	Corrosion of household plumbing systems; Erosion of natural deposits

NA: Not applicable
 ND: Not detected
 NR: Not reported
 MNR: Monitoring not required, but recommended.

ppm: parts per million, or milligrams per liter (mg/L)

ppb: parts per billion, or micrograms per liter (µg/L)

Important Drinking Water Definitions:

AL: Action Level: The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Contaminant: Any natural or man-made physical, chemical, biological, or radiological substance or matter in water, which is at a level that may have an adverse effect on public health, and which is known or anticipated to occur in public water systems.

Coliform: A group of bacteria commonly found in the environment. They are an indicator of potential contamination of water. Adequate and appropriate disinfection effectively destroys coliform bacteria.

Disinfection: A process that effectively destroys coliform bacteria.

MCL: Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG: Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

MRDLG: Maximum residual disinfection level goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

MRDL: Maximum residual disinfectant level. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Nitrates: A dissolved form of nitrogen found in fertilizers and sewage by-products that may leach into groundwater and other water sources. Nitrates may also occur naturally in some waters.

NTU: (Nephelometric turbidity unit) A measure of the clarity of water.

Pathogens: (Disease-causing pathogens, waterborne pathogens) A pathogen is a bacterium, virus, or parasite that causes or is capable of causing disease. Pathogens may contaminate water and cause waterborne disease.

pCi/L: (picocuries per liter) A measurement of radiation released by a set amount of a certain compound.

pH: A measure of the acidity or alkalinity of water.

ppb, ppm: (Part per billion, part per million) Measurements of the amount of contaminant per unit of water. A part per million is like one cent in \$10,000 and a part per billion is like one cent in \$10,000,000.

THM: (Trihalomethanes) Four separate compounds (chloroform, dichlorobromomethane, dibromochloromethane, and bromoform) that form as a result of disinfection.

Violations:

Lead

Infants and children who drink water containing lead in excess of the action level could experience delays in their physical or mental development. Children could show slight deficits in attention span and learning abilities. Adults who drink this water over many years could develop kidney problems or high blood pressure.